

XCSR210MDB

Telemecanique Safety switches XCS,
diagnostic module for XCSRC Daisy Chain
models, Modbus RTU



Main

Range of product	Telemecanique Safety switches XCS
Accessory / separate part categor	Diagnostic accessories
Accessory / separate part type	Diagnostic module

Complementary

Product compatibility	XCSRC.2M12
Accessory / separate part destination	RFID safety switch
Local signalling	Green, orange and red 2 LEDs
Kit composition	Diagnostic module Quick start guide EU declaration
[Ue] rated operational voltage	24 V DC (- 20...10 %)SELV or PELV
Net weight	0.1 kg


Packing Units

Unit Type of Package 1	PCE
Number of Units in Package 1	1
Package 1 Height	6.500 cm
Package 1 Width	4.300 cm
Package 1 Length	9.500 cm
Package 1 Weight	117.000 g
Unit Type of Package 2	S01
Number of Units in Package 2	12
Package 2 Height	15 cm
Package 2 Width	15 cm
Package 2 Length	40 cm
Package 2 Weight	1.591 kg

Offer Sustainability

Sustainable offer status	Green Premium product
Circularity Profile	No need of specific recycling operations
California proposition 65	WARNING: This product can expose you to chemicals including: Diisononyl phthalate (DINP), which is known to the State of California to cause cancer, and Diisodecyl phthalate (DIDP), which is known to the State of California to cause birth defects or other reproductive harm. For more information go to www.P65Warnings.ca.gov
For all Reach Rohs enquiries contact us at	sustainability@tesensors.com


Dimensions

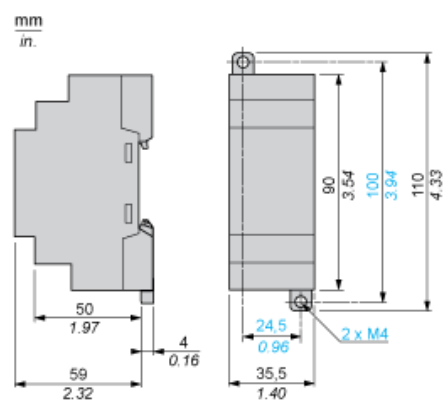

Connections

Wiring Diagram: Series Connection with Serial Diagnosis

Example of connection to a safety relay and the diagnostic module

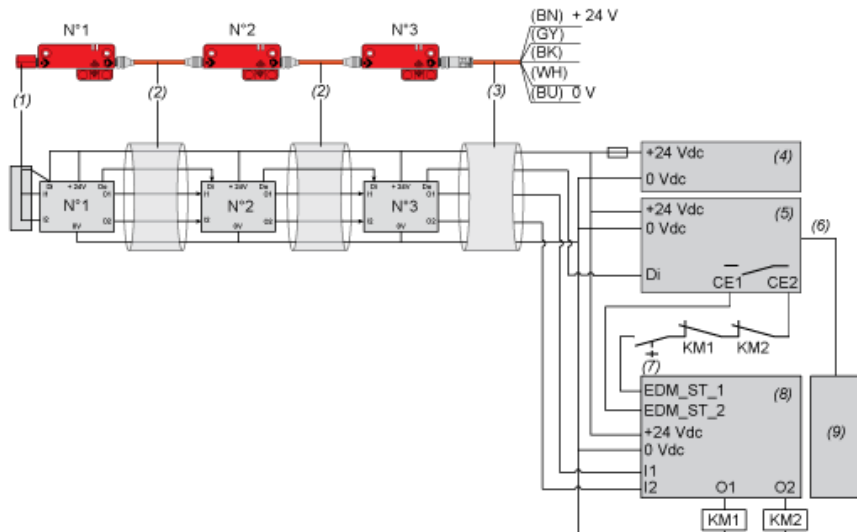

- Di: Diagnostic signal input
Do: Diagnostic signal output
I1: Safety Input 1
I2: Safety Input 2
O1: Safety Output 1
O2: Safety Output 2
CE1 Connections for Chain Error contact (used as external Start Condition - ESC)
&
CE2:
BN: Brown
GY: Grey
BK: Black
WH: White
BU: Blue
(1) Loopback device
(2) M12/M12 female jumpers
(3) Pre-wired female connector
(4) SELV/PELV Power Supply
(5) Diagnostic module (option)
(6) Cable for Modbus RTU serial link
(7) Start
(8) Safety relay
(9) HMI or PLC

NOTE: KM1 and KM2 contactors must have force-guided contacts.